



# PT10R-1008-IX-DA91 Pressure Transmitter – With Current Output (2-Wire)

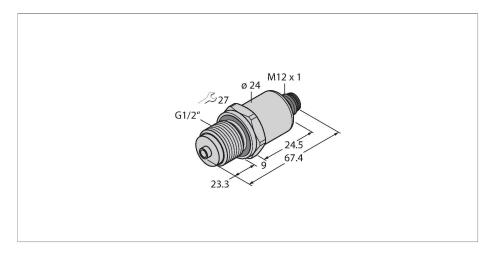


#### **Features**

- Ceramic measuring cell
- Compact and robust design
- Excellent EMC properties
- Pressure range 0...10 bar rel.
- ■10...30 VDC
- ■Analog output 4...20 mA
- Process connection G1/2" male thread, back sealing and manometer (combi)
- Connector device, M12 × 1
- ■ATEX, IECEx
- Category II 1/2 GD, Ex zone 0

## Wiring diagram

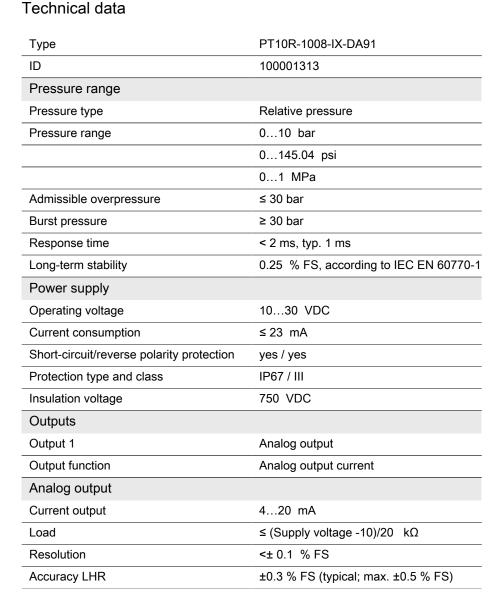






### Functional principle

The pressure sensors in the PT...-1000 product series operate with a ceramic measuring cell in various pressure ranges of up to -1...60 bar in 2-, 3- or even 4-wire technology. Depending on the sensor variant, the processed signal is available as an analog output signal (4...20 mA, 0...10 V, 0...5 V, 1... 6 V, ratiometric) or as a digital IO-Link process parameter. The IO-Link sensor variants also have two independently configurable switching outputs.

In addition to the standard variants, there are special sensors for uses such as ATEX areas or for oxygen applications.

A wide range of process connections and electrical connections offer a high degree of flexibility in a wide range of applications.



# Technical data

Temperature behaviour		
Medium temperature	-30+120 °C	
Temperature coefficient	± 0.2 % of full scale/10 K	
Environmental conditions		
Ambient temperature	-25+85 °C	
Storage temperature	-50+100 °C	
Vibration resistance	20 g, 152000 Hz, 1525 Hz with amplitude ± 15 mm, 1 octave/minute in all 3 directions, 50 continuous loads, acc. to IEC 68-2-6	
Shock resistance	100 g, 11 ms, half sinusoidal curve, all 6 directions, free fall from 1 m onto concrete (6x) acc. to IEC 68-2-27	
Mechanical data		
Housing material	Stainless-steel/Plastic, 1.4404 (AISI 316L)/polyarylamide 50 % GF UL 94 V-0	
Pressure connection material	Stainless steel 1.4404 (AISI 316L)	
Pressure transducer material	Ceramic Al₂O₃	
Sealing material	FPM spez.	
Process connection	G 1/2" male thread, rear sealing and manometer (combi)	
Wrench size pressure connection / coupling nut	27	
Electrical connection	Connector, M12 × 1	
Max. tightening torque of housing nut	30 Nm	
Reference conditions acc. to IEC 61298-1	30 Nm	
Reference conditions acc. to IEC	30 Nm 15+25 °C	
Reference conditions acc. to IEC 61298-1		
Reference conditions acc. to IEC 61298-1 Temperature	15+25 °C	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure	15+25 °C 8601060 hPa abs.	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity	15+25 °C 8601060 hPa abs. 4575 % rel.	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power	15+25 °C 8601060 hPa abs. 4575 % rel.	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals	15+25 °C 8601060 hPa abs. 4575 % rel. 24 VDC	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals Approvals	15+25 °C 8601060 hPa abs. 4575 % rel. 24 VDC	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals Approvals UL registration number	15+25 °C  8601060 hPa abs.  4575 % rel.  24 VDC  cULus  E302799  For intrinsically safe applications, the values specified in the corresponding Ex certificates (ATEX, IECEX,	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals Approvals UL registration number Important note	15+25 °C  8601060 hPa abs.  4575 % rel.  24 VDC  cULus  E302799  For intrinsically safe applications, the values specified in the corresponding Ex certificates (ATEX, IECEX, UL etc.) apply.	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals Approvals UL registration number Important note  Ex approval acc. to conformity certificate	15+25 °C 8601060 hPa abs. 4575 % rel. 24 VDC  cULus E302799  For intrinsically safe applications, the values specified in the corresponding Ex certificates (ATEX, IECEX, UL etc.) apply.  SEV 16 ATEX 0145	
Reference conditions acc. to IEC 61298-1 Temperature Atmospheric pressure Humidity Auxiliary power Tests/approvals Approvals UL registration number Important note  Ex approval acc. to conformity certificate Application area	15+25 °C  8601060 hPa abs.  4575 % rel.  24 VDC  CULus  E302799  For intrinsically safe applications, the values specified in the corresponding Ex certificates (ATEX, IECEX, UL etc.) apply.  SEV 16 ATEX 0145  II 1/2 GD	



# Accessories

Dimension drawing	Туре	ID	
M12x1 ø 15 / 14  + 11.5 - 42	RKC4.441T-2/	TEB 6628444	Connection cable, M12 female connector, straight, 4-pin, cable length: 2 m, jacket material: PVC, blue; cULus approval
M12 x 1 0 15 25 14	RKC4.441T-2/	TXB 6631010	Connection cable, M12 female connector, straight, 4-pin, cable length: 2 m, jacket material: PUR, blue; cULus approval
0 15 M12 x 1 26.5	WKC4.441T-2/	TEB 6628451	Connection cable, M12 female connector, angled, 4-pin, cable length: 2 m, jacket material: PVC, blue; cULus approval
0 15 M12 x 1 26.5 32	WKC4.441T-2/	TXB 6629180	Connection cable, M12 female connector, angled, 4-pin, cable length: 2 m, jacket material: PUR, blue; cULus approval



#### Instructions for use

#### Intended use

This device fulfills Directive 2014/34/EU and is suited for use in areas exposed to explosion hazards according to EN 60079-0:2012 + A11:2013, EN 60079-11:2012 and EN 60079-26:2015. In order to ensure correct operation according to the intended purpose, the national regulations and directives must be observed.

For use in explosion hazardous areas conform to classification

The sensors may be used only in dust or gas areas

Marking (see device or technical data sheet)

II 1/2 GD Ex ia IIC T4 Ga/Gb and Ex ia IIIC T125°C Da/Db acc. to EN60079-0:12+A11:2013

#### Installation/Commissioning

These devices may only be installed, connected and operated by trained and qualified staff. Qualified staff must have knowledge of protection classes, directives and regulations concerning electrical equipment designed for use in explosion hazardous areas. Please verify that the classification and the marking on the device comply with the actual application conditions.

This device is only suited for connection to approved Exi circuits according to EN 60079-0 and EN 60079-11. Please observe the maximum admissible electrical values. After connection to other circuits the sensor may no longer be used in Exi installations. When interconnected to (associated) electrical equipment, it is required to perform the "Proof of intrinsic safety" (EN60079-14).

#### Installation and mounting instructions

Avoid static charging of cables and plastic devices. Please only clean the device with a damp cloth. Do not install the device in a dust flow and avoid build-up of dust deposits on the device. If the devices and the cable could be subject to mechanical damage, they must be protected accordingly. They must also be shielded against strong electro-magnetic fields. The pin configuration and the electrical specifications can be taken from the device marking or the technical data sheet. In order to avoid contamination of the device, please remove possible blanking plugs of the cable glands or connectors only shortly before inserting the cable or opening the cable socket.

#### Special conditions for safe operation

The device must be protected against any kind of mechanical damage.

#### Service/Maintenance

Repairs are not possible. The approval expires if the device is repaired or modified by a person other than the manufacturer. The most important data from the approval are listed.